


BEDDING RECOMMENDATIONS VYLON PIPE

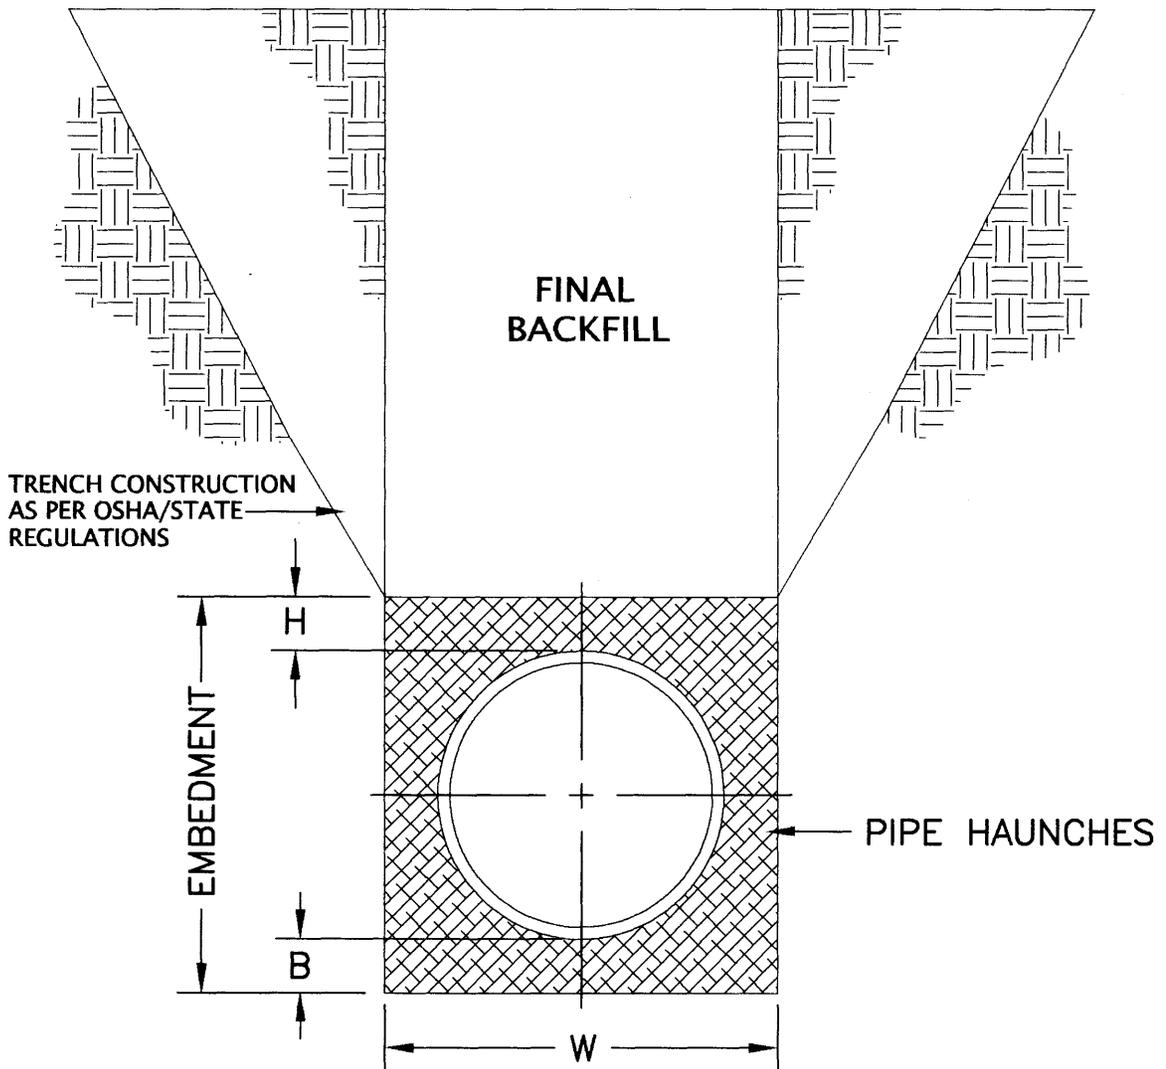

NOTES:

1. PIPE SHALL BE INSTALLED IN ACCORDANCE WITH ASTM D2321
2. CLASS I, II, OR III MATERIALS ARE ACCEPTABLE, ALTHOUGH CLASS I MATERIALS PROVIDE SUFFICIENT SUPPORT FOR MOST INSTALLATIONS IF THE MATERIAL IS SHOVEL SLICED UNDER THE HAUNCHES. CLASS II OR CLASS III MATERIALS REQUIRE COMPACTING IN LIFTS TO A MINIMUM 95% STANDARD PROCTOR DENSITY.
3. "H" AND "B" SHALL BE 6" MINIMUM, "W" IS A MINIMUM OF THE PIPE OD + 18"
4. IF THE MIGRATION OF FINES FROM ADJACENT MATERIALS IS EXPECTED CONSIDERATION SHOULD BE GIVEN TO USE OF A GEOTEXTILE OR SOME OTHER MEANS TO PREVENT LOSS OF PIPE SUPPORT.
5. WEAK NATIVE SOILS, SUCH AS THOSE WITH BLOW COUNTS OF 5 OR LESS, MAY REQUIRE ADDITIONAL MEASURES TO PROVIDE A SUFFICIENT FOUNDATION UNDER THE PIPE AND/OR PROVIDE SUFFICIENT LATERAL SUPPORT. SEE ASTM D 2321 FOR FURTHER INFORMATION.